




27EA - Direct Drive Centrifugal Wall Ventilator

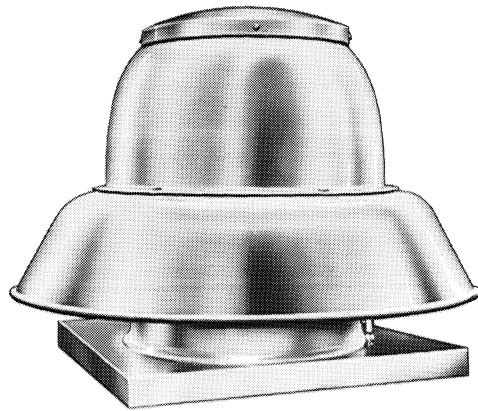



27EB - Direct Drive Centrifugal Roof Ventilator
27EC - Belt Drive Centrifugal Roof Ventilator

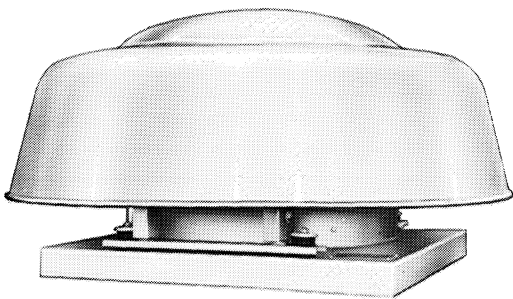

27ED - Belt Drive Low Silhouette Centrifugal
Roof Ventilator

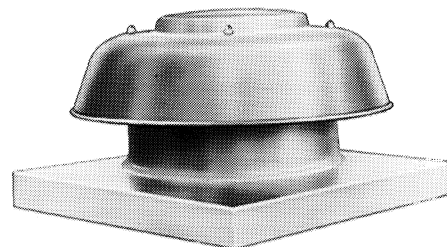

27EE - Direct Drive Axial Roof Ventilator

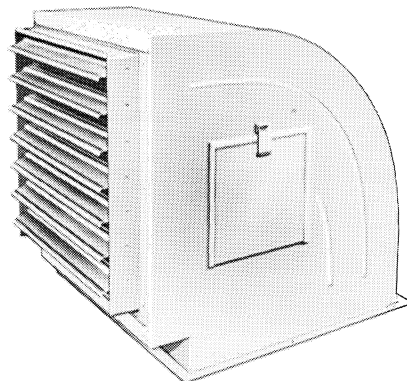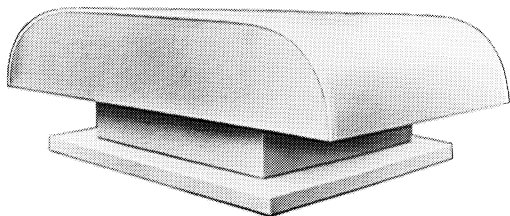



POWER VENTILATORS AND PROPELLER FANS

27E

CARRIER AIR CONDITIONING COMPANY			
MODEL		<input type="text"/>	
FAN			
CFM	<input type="text"/>	SP	<input type="text"/>
RPM	<input type="text"/>	HP	<input type="text"/>
MOTOR			
VLT	<input type="text"/>	CY	<input type="text"/>
AMP	<input type="text"/>	PH	<input type="text"/>

Unit Serial Name Plate

ORDERING INSTRUCTIONS FOR REPLACEMENT PARTS

USED ON 27EA, EB, EC, ED, EE, EF, EG, AND EH FAN UNITS

- MOTORS

Repair or replace locally. If a replacement is unavailable locally, order from Carrier (see address below) by giving complete Motor nameplate data (frame size, hp, manufacturer, voltage, phase, etc.) and the unit serial nameplate data (unit size, serial number, etc.)
- BEARINGS

Replace locally. If a replacement is unavailable, order from Carrier (see address below) by giving complete Bearing nameplate data (manufacturer, manufacturer's part number, bore size, etc.) and the unit serial nameplate data (unit size, serial number, etc.)
- DRIVES

Belts and Pulleys are to be replaced locally.
- FANS, SHAFTS,
CASING PARTS,
AND
ACCESSORIES

Order from Carrier (see address below) by giving complete unit serial nameplate data (unit size, serial number, etc.)
- ADDRESS ALL
CARRIER ORDERS
TO:

Carrier Air Conditioning Company
Parts Department
Post Office Box 845
Syracuse, New York 13201